

Original operating manual: Glass Fibre Optics



MSM-\*\*\*\*-02-L-KL-OP1 / MSM-\*\*\*\*-02-L-KL-OP2 / MSM-\*\*\*\*-02-L-KL

IECEX BVS 14.0108X




- Yellow brass protection sheath, for light barrier measurement method
- MSM-\*\*\*\*-02-L-KL-OP1: Authorized for Ex zones 0, 1, 2, 20, 21, 22
- MSM-\*\*\*\*-02-L-KL-OP2: Authorized for Ex zones 1, 2, 21, 22
- MSM-\*\*\*\*-02-L-KL: Applicable only in Non-Hazardous Locations



Ex op is IIC T4 Ga / Ex op is IIIB T135°C Da  
or  
Ex op is IIB T4 Gb / Ex op is IIIB T135°C Db

Technical data	Type	MSM-****-02-L-KL-OP1	MSM-****-02-L-KL-OP2	MSM-****-02-L-KL
Standard length and designation		****=Length in mm, 200, 500, 1000, 1500, 2000 (Overall length)		
Ex Protection, Gas		II 1G IIC T4 Ga	II 2G IIB T4 Gb	none
Ex Protection, Dust		II 1D IIIB T135°C Da	II 2D IIIB T135°C Db	none
Applicable in Ex Zones		0, 1, 2, 20, 21, 22	1, 2, 21, 22	--
Requirement at connected sensors		Ex op is Ga/Da	Ex op is Gb/Db	none
Maximum optical input power		<=15mW	<=35mW	not limited
Maximum potential radiant intensity		<=5mW/mm <sup>2</sup>	<=5mW/mm <sup>2</sup>	not limited
Active fibre optic diameter		2 mm		
Active cross-sectional area		3.14mm <sup>2</sup>		
Transmission rate, average		50-70%, at 870nm		
Optical aperture		appr. 65°, at 870nm		
Individual fibre diameter		50um		
Minimum bending radius		30mm (Single bend)		
Operating temperature range T <sub>amb</sub>		-20°C < T <sub>amb</sub> < +120°C		-20°C < T <sub>amb</sub> < +120°C
Enclosure rating, according to EN 60529		IP68		
Material, adaption probe tip		Special steel, 1.4305		
Material, probe tip		Special steel, 1.4305		
Material, protection sheath		Brass, chromium plated		
Accessories, included		2 x Shrink-down plastic tubing	--	
Accessories, not included		- Additional optics type OT-VA (Material: brass, Ni plated)		
Options		- Type MSM-****-02-L-KL-OP1-S247: Without shrink-down plastic tubing		

**ATEX/IECEX RELATED MARKINGS**  
 CE 0158 T<sub>amb</sub> = -20°C < T<sub>amb</sub> < +120°C Manufacturer with address  
 Date of production: Numerals 5 to 8 of the serial number (Year/Week) Date of production: Numerals 5 to 8 of the serial number (year / calendar week)  
 Type: MSM-\*\*\*\*-02-L-KL-OP1(-S247) II 1G IIC T4 Ga, II 1D IIIB T135°C Da EC-Certification No. BVS 10 ATEX E 130 X. DEKRA  
 Type: MSM-\*\*\*\*-02-L-KL-OP2 II 2G IIB T4 Gb, II 2D IIIB T135°C Db IECEx-Certification No. IECEx 14.0108X  
 (X designation of the certification number: Fibre optics must only be applied with sensors with certificated limited optical power)

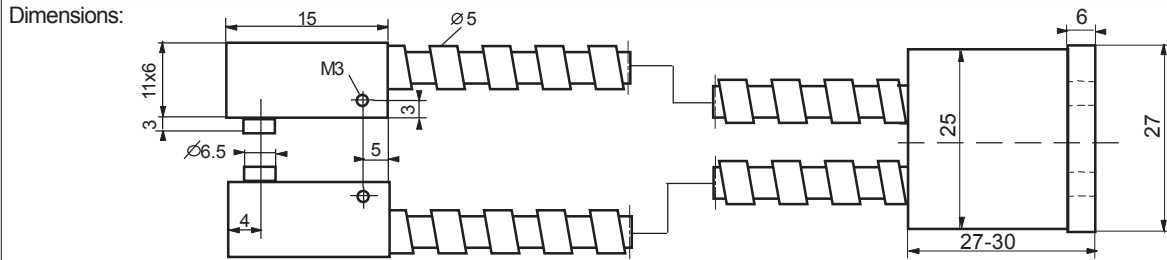

Operating Manual / EU - Declaration of Conformity:

**Ex mounting prescriptions**  
 Type MSM-\*\*\*\*-02-L-KL-OP1(-S247): Applicable in Ex zones 0, 1, 2, 20, 21, 22.  
 Type MSM-\*\*\*\*-02-L-KL-OP2: Only applicable in Ex zones 1, 2, 21, 22.

**General regulations for all types:**  
 The maximum rated optical input power must not be exceeded. The local equipotential bonding have to be done by grounding the fixed sensor. It is necessary to take into consideration the valid international and national rules and regulations (EN 60079-14). Other than original manufacturer, additional optical lenses are not allowed in hazardous locations. The fibre optics have to be installed in a manner to avoid tensile stress and frictional heat. If fibre optics and associated sensors are not mounted in the same hazardous location, the change over of the different areas must be realized in accordance with the valid regulations. With the additional shrink-down plastic tubings (only types MSM-\*\*\*\*-02-L-KL-OP1, not included for the type MSM-\*\*\*\*-02-L-KL-OP1-S247) a required change over can be realized.  
**Function**  
 The fibre optics series MSM are designed for the construction of light barrier measurement method arrangements in hazardous locations and for high ambient temperatures. The fibre optics can be operated with certificated Matrix sensors, with an optical wave length from 500nm to 900nm. The fibre optics must not be buckled or laid with a small radius. Buckled or bad laid fibre optics results to a strong decrease of performance. Avoid performance decreasing and failures caused by wear, by a functional mounting of the fibre optics.  
**Maintenance**  
 The fibre optics are maintenance-free. Protect the fibre optics against pollution. If they are contaminated, clean with alcohol. Do not use aggressive

solvents. Equipment must only be repaired or serviced by the manufacturer.  
**Safety Informations**  
 When installing and operating, it is necessary to take into consideration the relevant international and other national regulations. EN 60079-14, ATEX 118a, single directive 1999/92/EC.  
 Standards met:  
 EN 60079-0:2012 + A11:2013, EN 60079-28:2007, EN 60529:2014  
 ATEX directive: 2014/34/EU, Machine directive: 2006/42/EC,  
 RoHS directive: 2011/65/EU

**General Notes, disposal**  
 We reserve the right to modify our equipment. Our equipment is designed such way, that it has the least possible adverse effect on the environment. No longer usable or irreparable units must be disposed of in accordance with local waste disposal regulations.

**EU-Declaration of Conformity**  
 IECEx certification No. BVS 14.0108X.  
<http://iecex.iec.ch/iecex/iecexweb.nsf/0FE79714C0BAEF6F5C1257D7E0044F6A9?opendocument>  
 ATEX certification: Certification No. BVS 10 ATEX E 130 X, DEKRA EXAM GmbH, Zertifizierungsstelle, Carl-Beyling-Haus, Dinendahlstrasse 9, D-44809 Bochum, Ident No. 0158.  
 ATEX certification of quality type production of Ex devices in accordance to the ATEX directive 2014/34/EU, CE 0158. Certification No: BVS 18 ATEX ZQS / E118. The conformity of the devices with the EC standards and directives and the EC-type examination certificate and the observation of the Quality Safety System ISO 9001:2015 with the ATEX module "Production", declares:  
 Pablo Ledergerber, Matrix Elektronik AG

Tippkemper - Matrix GmbH  
 Meesener Str. 43 D-51491 Overath  
 Tel.: +49 2206 9566-0 Fax - 19  
 info@tippkemper-matrix.com

Matrix Elektronik AG (Manufacturer)  
 Kirchweg 24 CH-5420 Ehrendingen  
 Tel.: +41 56 20400-20 Fax - 29  
 info@matrix-elektronik.com

MSM-xxxx-02-L-KL-OP1-IECEX\_e3/2019-08-15/MP